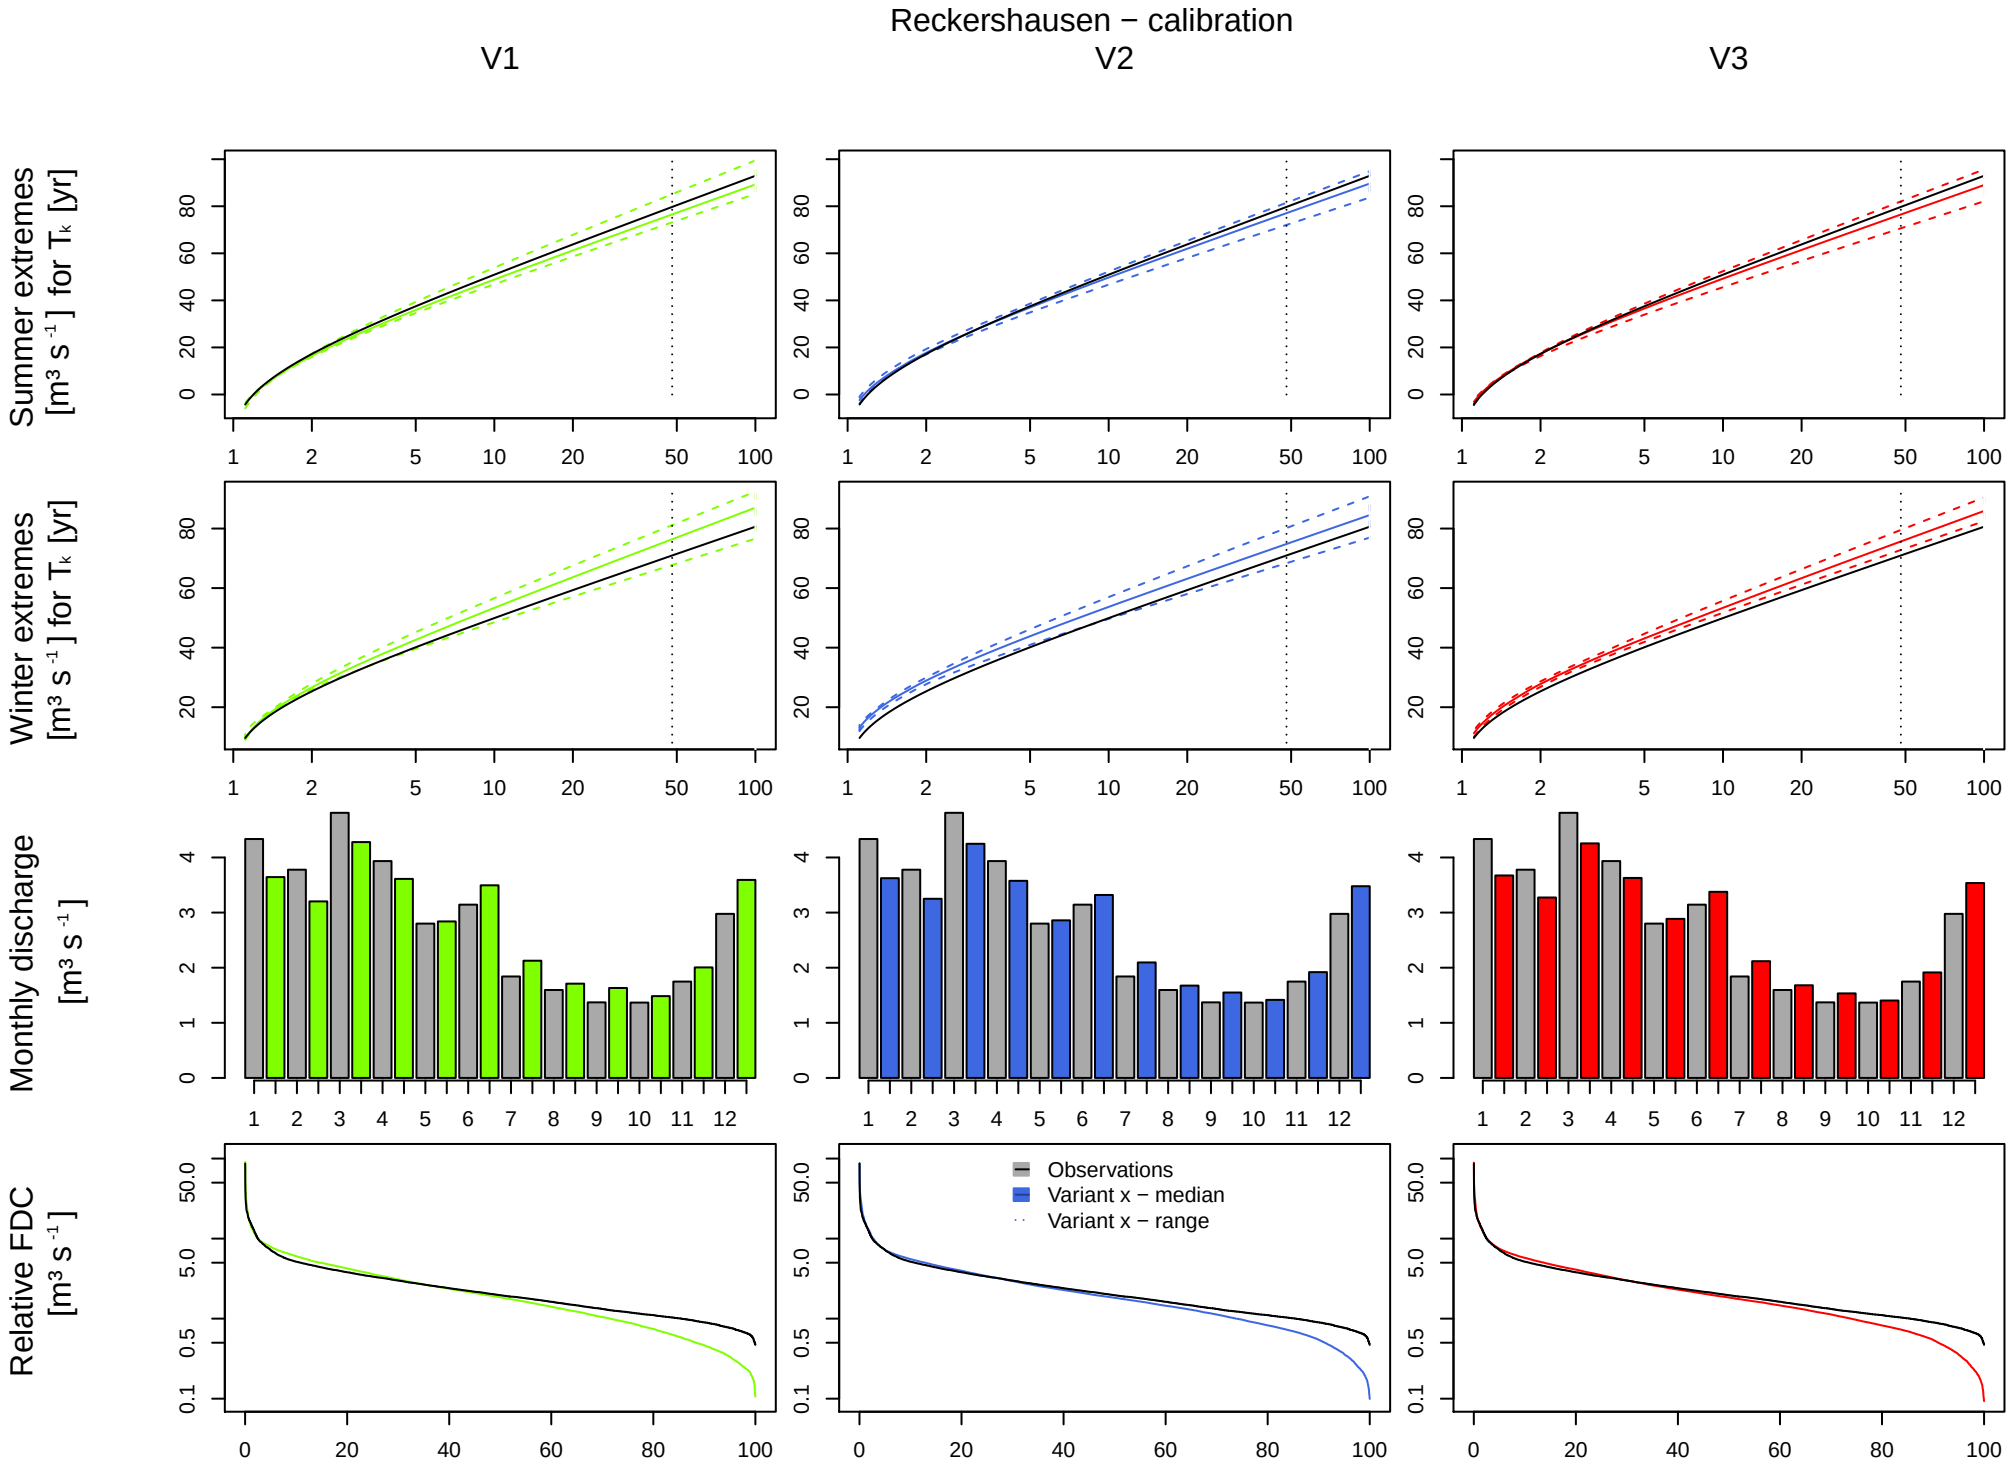
Reckershausen − calibration
V1
V2
V3
Summer extremes [m³ s⁻¹] for Tₖ [yr]
Winter extremes [m³ s⁻¹] for Tₖ [yr]
Monthly discharge [m³ s⁻¹]
Relative FDC [m³ s⁻¹]
Observations
Variant x − median
Variant x − range